

FIG.1

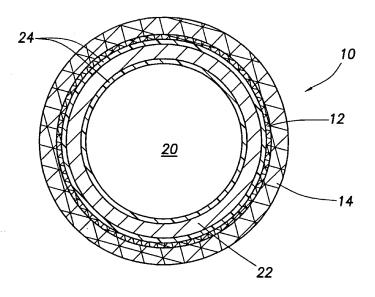


FIG.2

DS991EIS ILCEED1

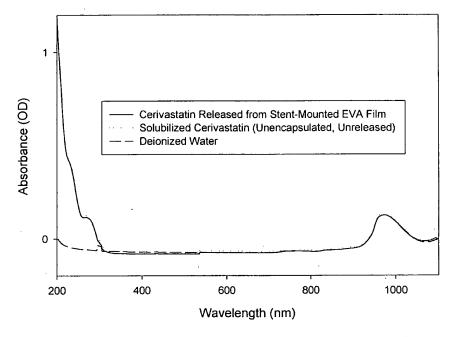


Figure 4: UV-VIS spectra comparison of cerivastatin released from EVA film and pure cerivastatin in deionized water

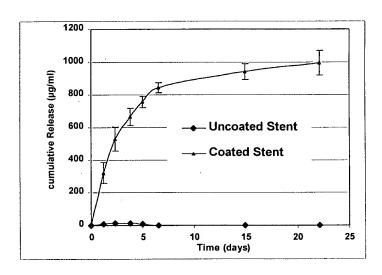


Figure 5: Cerivastatin release profile from EVA film wrapped on a stent

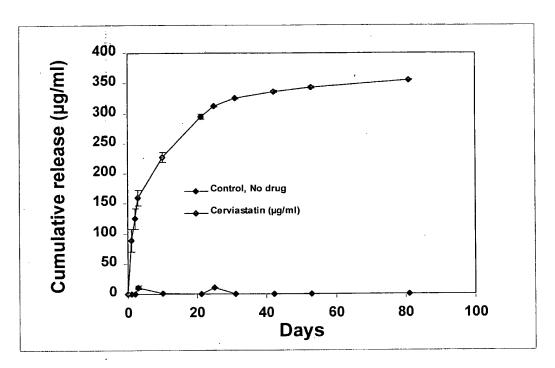


Figure 6: Cerivastatin release profile from polycaprolactone wrapped on the stent.

50 40 20 10 0 5 10 15 20 25 Time (days)

Figure 7: Release of cerivastatin from silicone coated stent

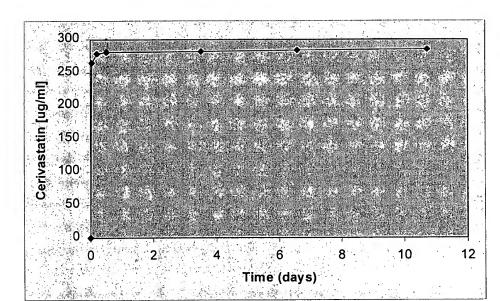


Figure 8: Release of cerivastatin from liquid vitamin E carrier